
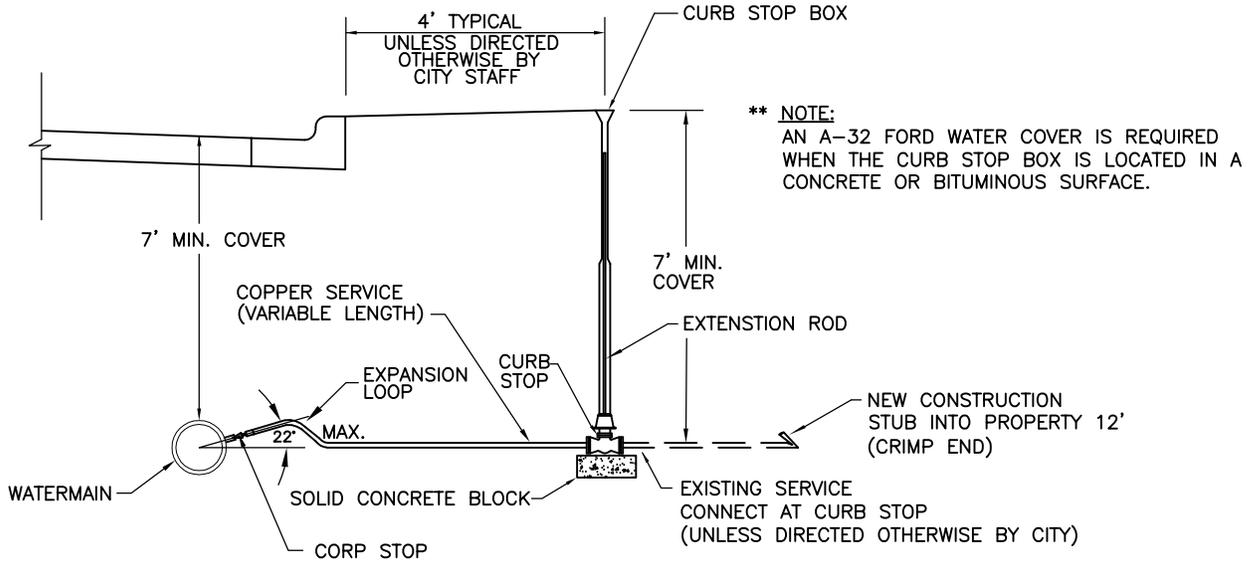


FORD STYLE			
ITEM	1"	1 1/2"	2"
CORP STOP	FB 1000-4-Q	FB 1000-6-Q	FB 1000-7-Q
SERVICE SADDLES	N/A	F-202-(**)-CC6	F-202-(**)-CC7
CURB STOP	B44-444M-Q	B44-666M-Q	B44-777M-Q
CURB STOP BOX	EM2-80-56-72R	EM2-80-57-72R	EM2-80-57-72R
COUPLINGS	C44-44-Q	C44-66-Q	C44-77-Q
REPAIR COUPLINGS	FRS202-(**)-CC4	FRS202-(**)-CC6	FRS202-(**)-CC7

(**) VARIES DEPENDING ON PIPE OD

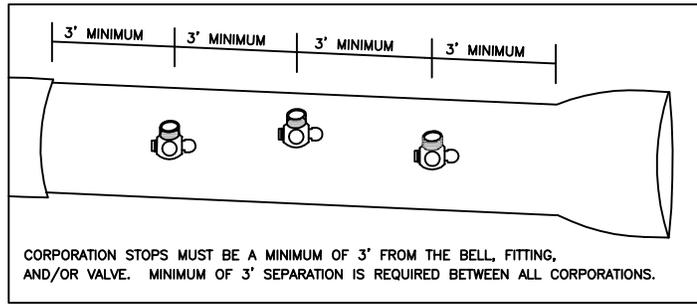

NOTE: WHERE NO EXISTING WATER SERVICE IS IN PLACE, EXTEND PAST PROPERTY LINE 12' AND CRIMP END OF COPPER.

CORPORATION STOPS, CURB STOPS & RELATED FITTINGS SHALL BE CAST BRASS WITH COMPRESSION FITTINGS
EXTENSION ROD SHALL EXTEND WITHIN 12" OF GROUND SURFACE

NO COUPLINGS ALLOWED BETWEEN WATERMAIN AND CURB STOP AND FROM THE CURB STOP TO THE STUBBED CRIMPED END OF THE COPPER (UNLESS DIRECTED OTHERWISE BY THE CITY).

AT THE END OF ALL SERVICES, WHICH ARE NOT IMMEDIATELY CONNECTED TO EXISTING SERVICES, THE CONTRACTOR SHALL MARK INVERT LOCATION WITH A 4"x4"x7' WOOD POST (MIN.). THERE SHOULD BE ATTACHED TO THE TOP OF THE POST A 6"x3/4" PIECE OF REROD, CAPABLE OF BEING LOCATED BY A METAL DETECTOR FROM THE FINISHED SURFACE. MARK SURFACE LOCATION ABOVE END OF SERVICE STUB AND THE CURB STOP EACH WITH A 6" HEAVY DUTY STEEL "TEE" FENCE POST PAINTED BLUE.

WATER SERVICE INSTALLATION DETAIL

NOT TO SCALE
PLATE 6002

WATER SERVICE INSTALLATION

STANDARD DETAIL
PLATE NO:
6002

APPROVED: ADOPTED BY CITY COUNCIL ON JANUARY 12, 2004

REVISED: REVISION ADOPTED BY CITY COUNCIL ON DECEMBER 12, 2005

REMARKS:

SAINT PETER UTILITY STANDARD DETAIL

