


NOTE:
TIE LAST JOINT IF LESS
THAN 8' FROM 90' TO
FIRST JOINT.

NOTE:
ALL ABOVE GROUND
INTERIOR FITTINGS
TO BE FLANGED.

OPTION 1 - MEGALUG RESTRAINT

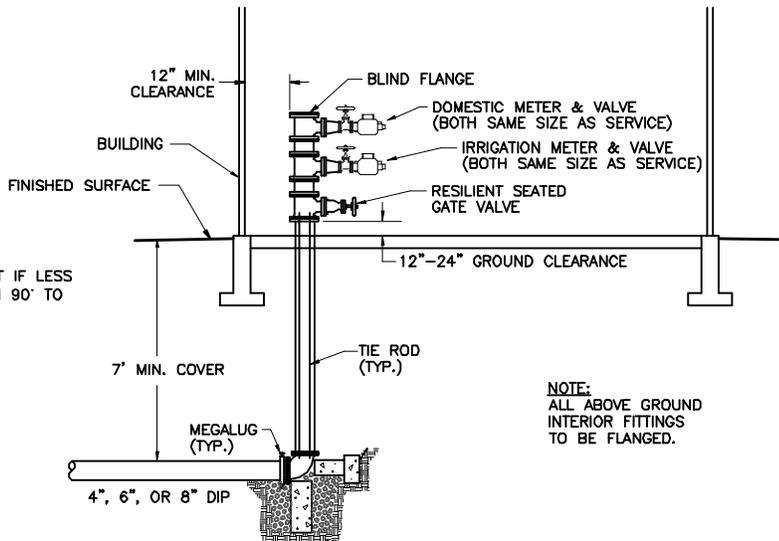

NOTE:
TIE LAST JOINT IF LESS
THAN 8' FROM 90' TO
FIRST JOINT.

NOTE:
ALL ABOVE GROUND
INTERIOR FITTINGS
TO BE FLANGED.

OPTION 2 - TIE-ROD RESTRAINT

**DUCTILE IRON PIPE WATER SERVICE
INTO BUILDING - (DUAL METER)
WITHOUT FIRE PROTECTION**

NOT TO SCALE
PLATE 6024

**DUCTILE IRON PIPE WATER SERVICE
INTO BUILDING - (DUAL METER)
WITHOUT FIRE PROTECTION**

STANDARD DETAIL
PLATE NO:
6024

APPROVED: ADOPTED BY CITY COUNCIL ON DECEMBER 12, 2005

REVISED: REVISION ADOPTED BY CITY COUNCIL ON MARCH 10, 2008

REMARKS:

SAINT PETER UTILITY STANDARD DETAIL



CITY OF
Saint Peter
NICOLLET COUNTY, MINNESOTA
WHERE HISTORY & PROGRESS MEET